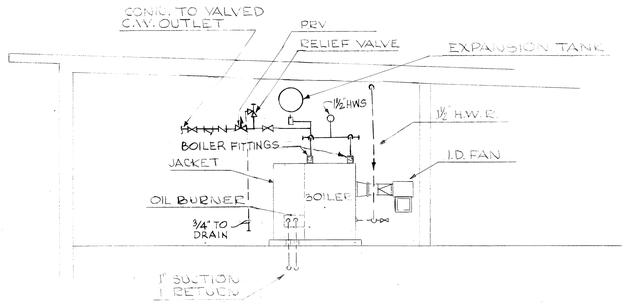

OIL FIRED

SECTION A 8/10 B 9/10

SCALE ¼" = 1'-0"

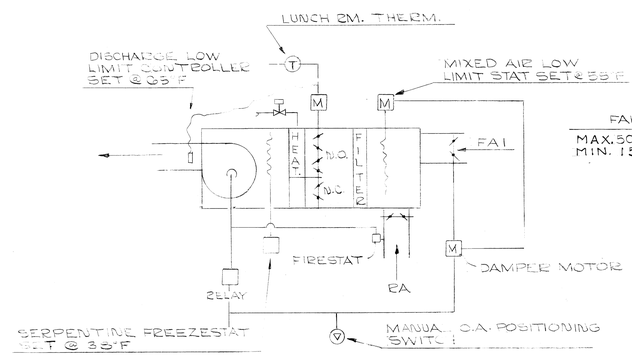

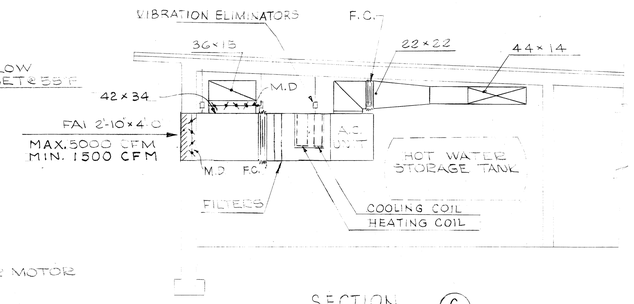

SECTION C 8/10

SCALE ¼" = 1'-0"

HEATING & VENTILATING CONTROL DIAGRAM

NOT TO SCALE

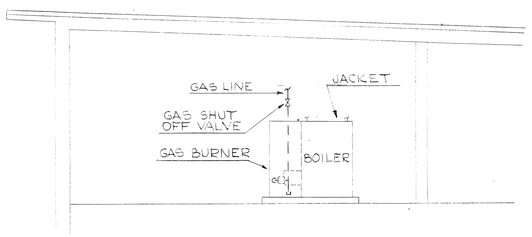

GAS FIRED

SECTION A 8/10 B 9/10

SCALE ¼" = 1'-0"

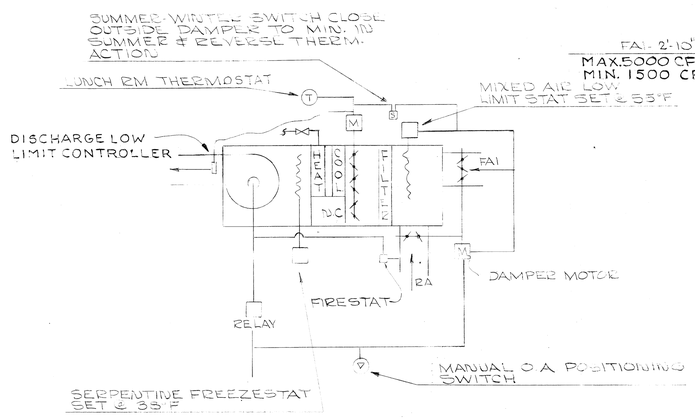

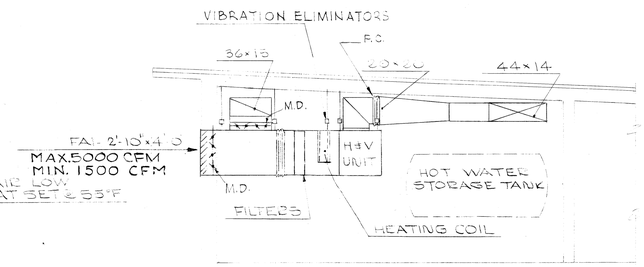

SECTION D 9/10

SCALE ¼" = 1'-0"

AIR CONDITIONING CONTROL DIAGRAM

NOT TO SCALE

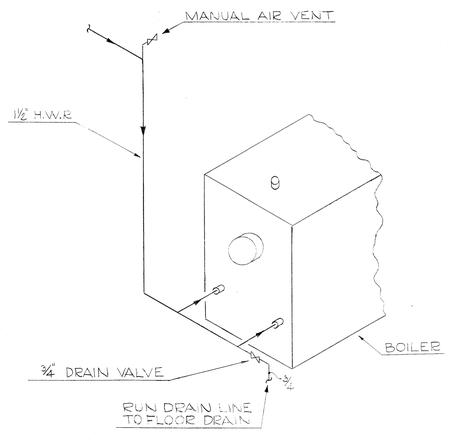

ISOMETRIC OF BOILER RETURN PIPING

NOT TO SCALE

1/4" = 1'-0"

SYMBOL	DESCRIPTION	DATE	APPROVAL

REVISIONS

AMMANN & WHITNEY
CONSULTING ENGINEERS
111-8TH AVENUE, NEW YORK, N.Y.

DEPARTMENT OF THE ARMY
OFFICE OF THE CHIEF OF ENGINEERS
MILITARY CONSTRUCTION - ENGINEERING DIVISION
WASHINGTON, D.C.

DRAWN BY: H.B.
TRACED BY: H.B.
CHECKED BY: S.B.
SUBMITTED: BY AMMANN & WHITNEY

AMMUNITION MAINTENANCE FACILITY

LUNCH ROOM - CHANGE HOUSE

ALTERNATE NO. 1 & 2

DETAIL, SECTIONS & CONTROL DIAGRAM

APPROVED: CHIEF UTILITIES BRANCH
APPROVED: CHIEF ENGINEERING DIVISION, MIL. CONSTR. O.C.E.
DATE: 18 JULY 1966

APPROVED FOR

DATE:

SCALE: AS NOTED
SPEC. NO. 16-06-324-66-OE

DRAWING NUMBER 36-49-03

SHEET 10 OF 10