CORPS OF ENGINEERS | 4 | 3 | 2 | 1 | U. S. ARMY

NOTES:

1. ALL ELECTRICAL WORK, INSIDE FENCE TO 20 FEET HEIGHTS, EXCEPT FLOODLIGHTS, IS WITHIN HAZARDOUS AREA AND SHALL CONFORM WITH CLASS I, GROUP D, DIVISION 1, T2D CLASSIFICATION OF THE NATIONAL ELECTRICAL CODE.
2. FOR DEVIATIONS FROM FACILITIES DEPICTED, SEE NOTES ON SHEET 2.
3. FOR LAYOUT OF ABOVE GROUND TANKS SEE SHEET NO. 22.
4. INSTALL A PROPERLY SIZED EQUIPMENT GROUNDING CONDUCTOR IN ALL CONDUITS CONTAINING LIGHTING AND POWER CIRCUITS

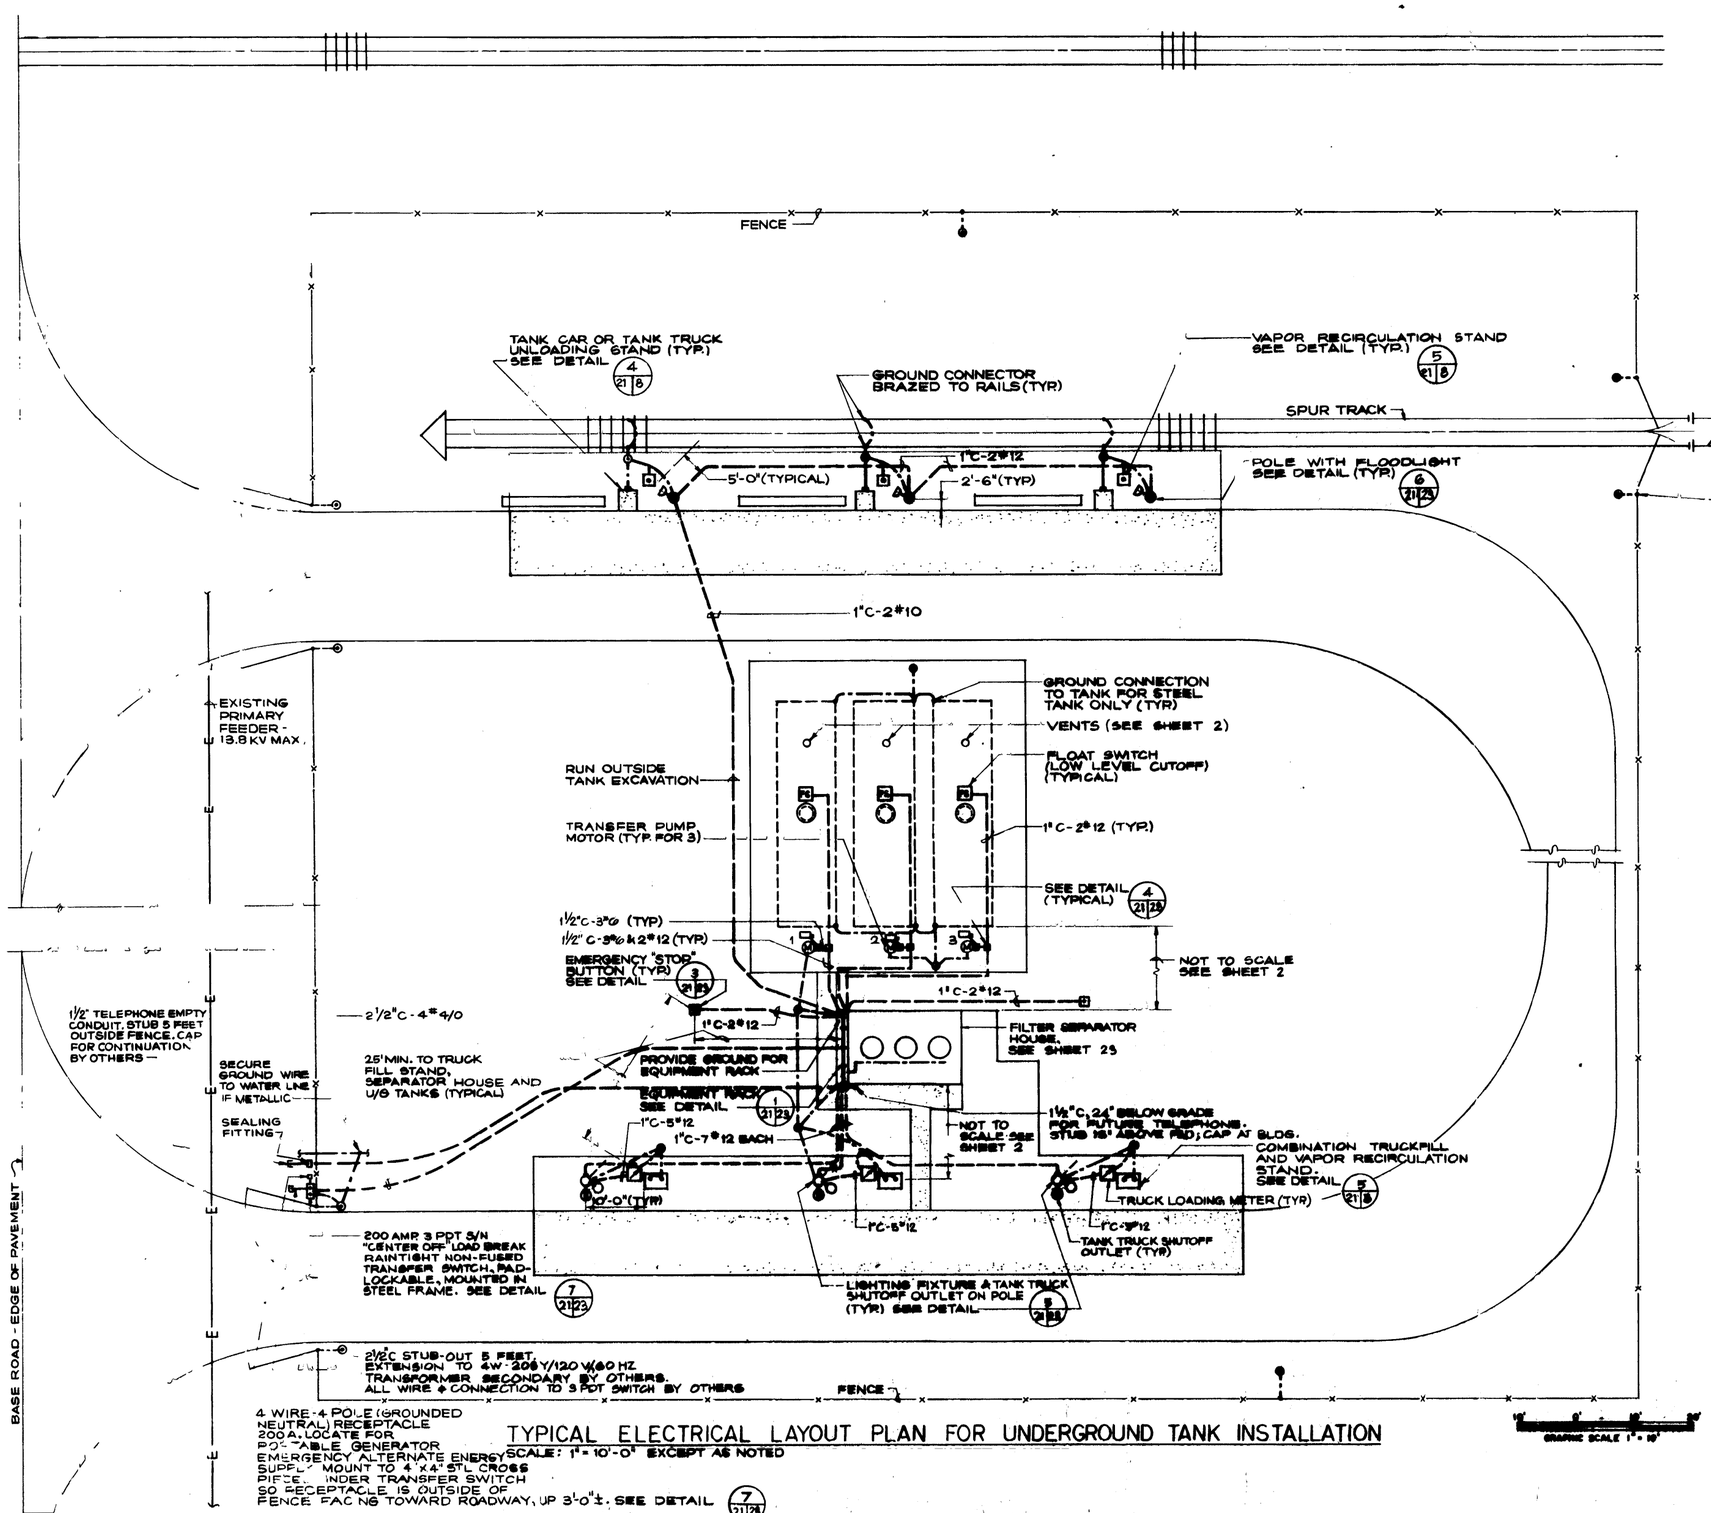

TYPICAL ELECTRICAL LAYOUT PLAN FOR UNDERGROUND TANK INSTALLATION

SCALE: 1" = 10'-0" EXCEPT AS NOTED

STAL. SYMB.		DATE	APPROVED

REVISIONS

KELLER & GANNON
ENGINEERS · ARCHITECTS · CONSULTANTS
555 BRANNAN STREET SAN FRANCISCO 94107

US ARMY ENGINEER DIVISION HUNTSVILLE
CORPS OF ENGINEERS
HUNTSVILLE, ALABAMA

STANDARD AIRCRAFT FUELING SYSTEM FOR ARMY AVIATION

TYPICAL ELECTRICAL DISTRIBUTION LAYOUT PLAN FOR UNDERGROUND TANKS

SHEET REF. NO.

DSGN. BY	DWN. BY	CKD. BY	FILE NO.	SIZE	DWG. NO.	REV.
C.P.E.	B.C.	TMR		F	78-24-20	

SPEC. NO. | DATE 5/13/63 | SHEET 21 OF 25