CORPS OF ENGINEERS | U.S. ARMY

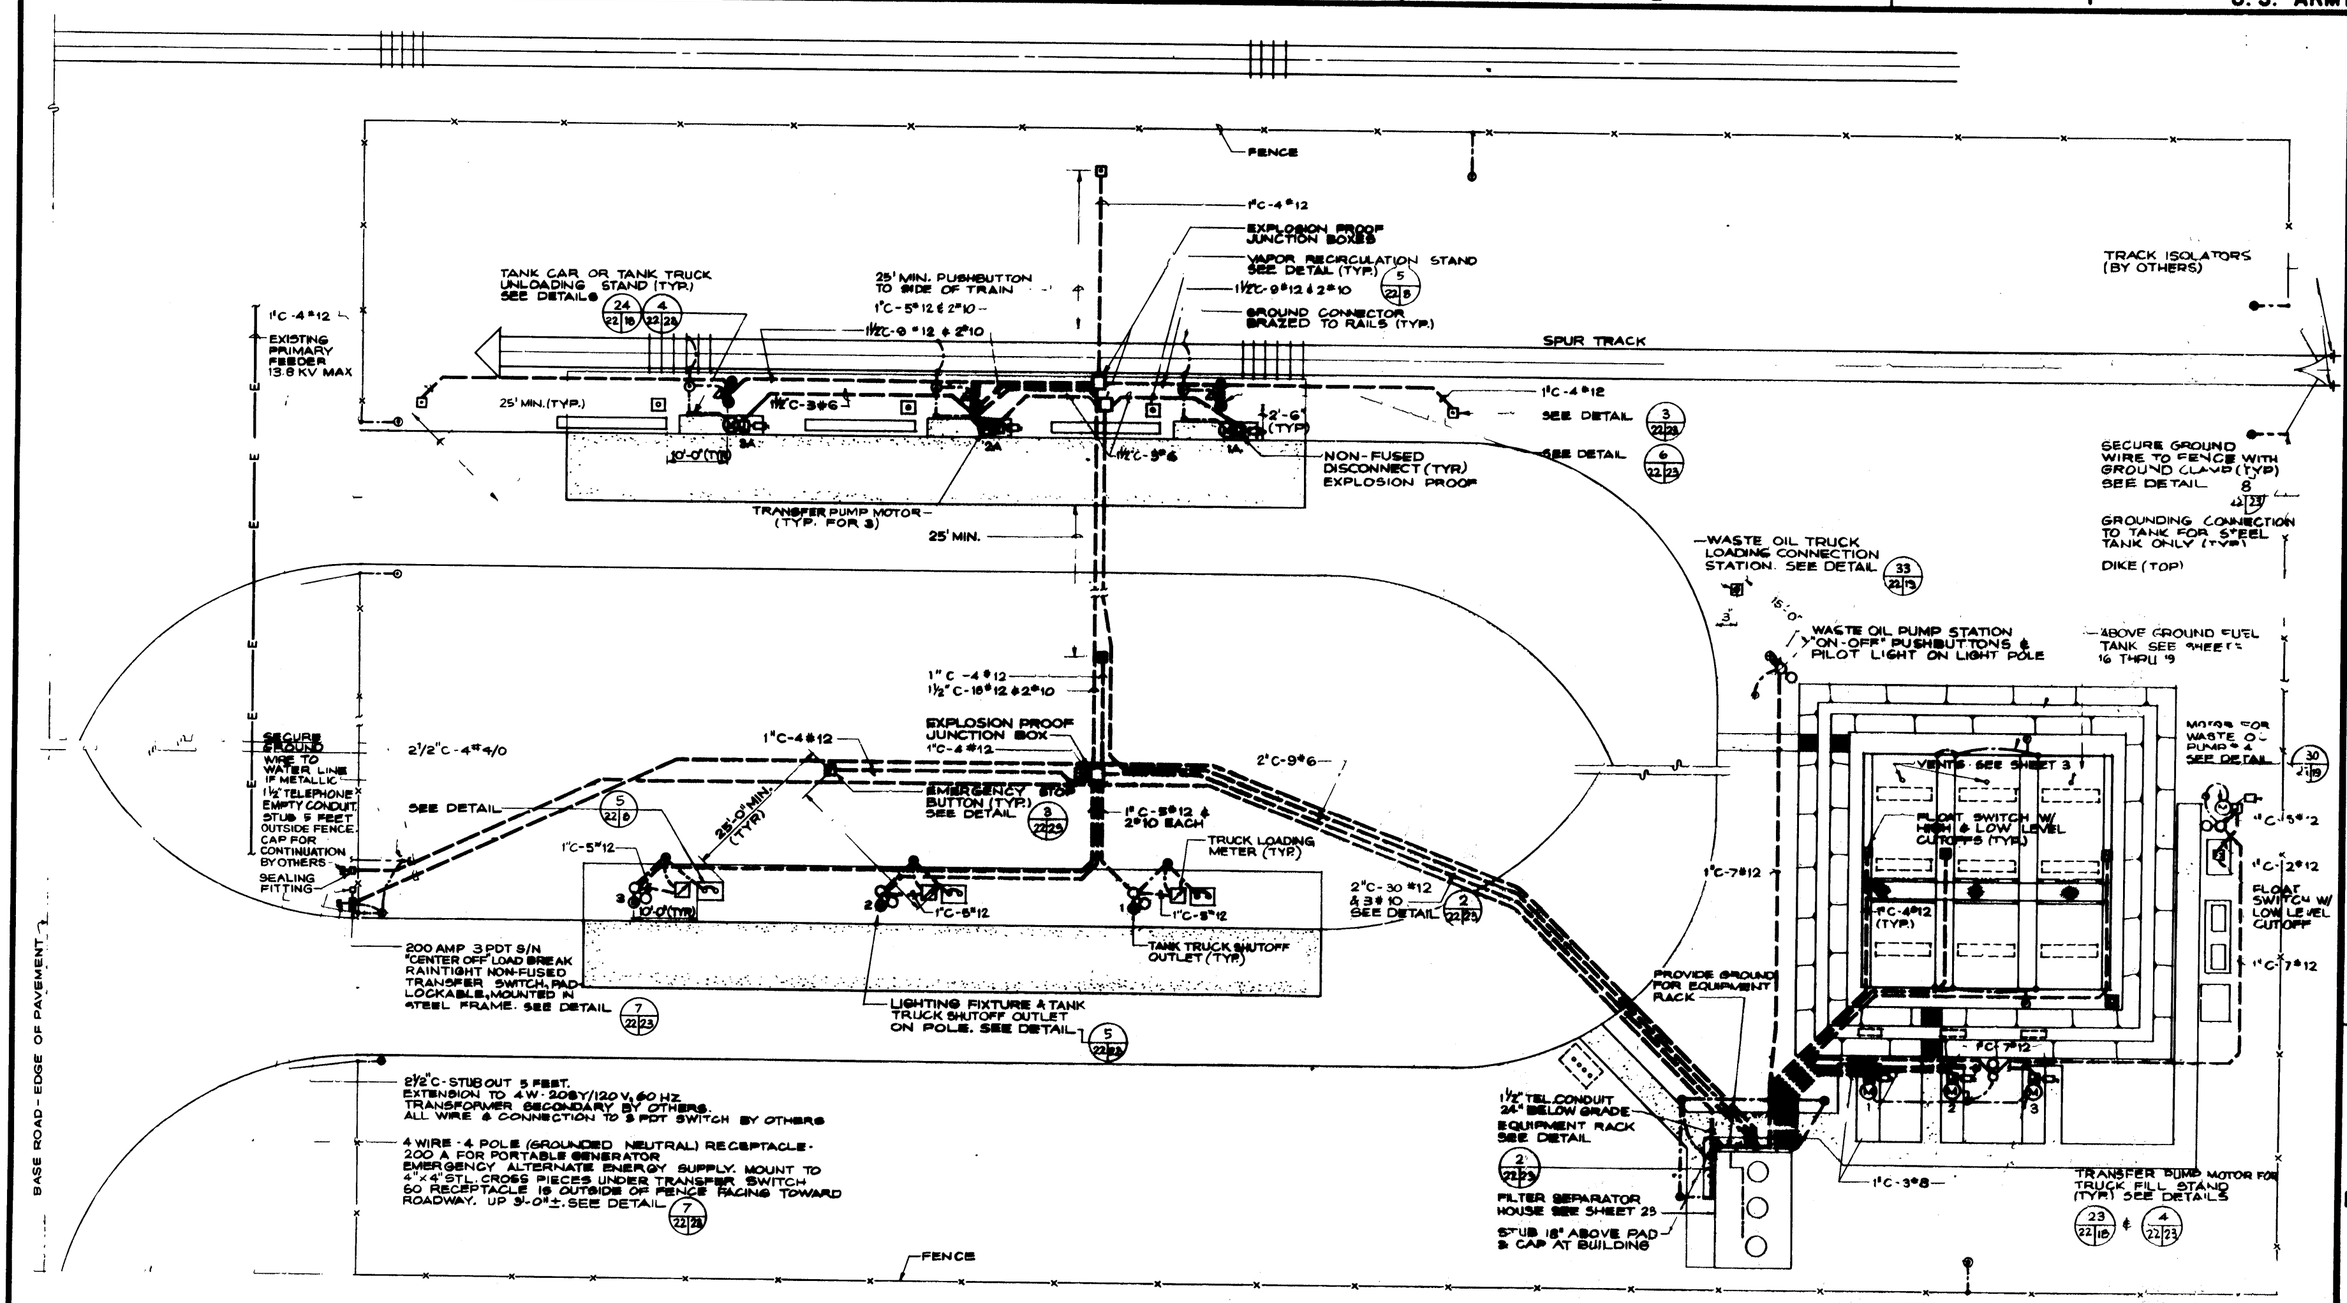

NOTES:

1. ALL ELECTRICAL WORK, INSIDE FENCE TO 20 FEET HEIGHT, EXCEPT FLOODLIGHTS, IS WITHIN HAZARDOUS AREA AND SHALL CONFORM WITH CLASS I, GROUP D, DIVISION 1, T2D CLASSIFICATION OF THE NATIONAL ELECTRICAL CODE.
2. FOR LAYOUT OF BELOWGROUND TANKS SEE SHEET NO. 21.
3. FOR DEVIATIONS FROM FACILITIES DEPICTED, SEE NOTES ON SHEET 3.

TYPICAL ELECTRICAL LAYOUT PLAN FOR ABOVEGROUND TANK INSTALLATION

SCALE: 1" = 10'-0" EXCEPT AS NOTED

GRAPHIC SCALE 1" = 10'

SYM.	DESCRIPTION	DATE	APPROVED
	REVISIONS		

KELLER & GANNON
ENGINEERS · ARCHITECTS · CONSULTANTS
THE EMBARCADERO STREET, SAN FRANCISCO 94105

US ARMY ENGINEER DIVISION HUNTSVILLE
CORPS OF ENGINEERS
HUNTSVILLE, ALABAMA

STANDARD AIRCRAFT FUELING SYSTEM FOR ARMY AVIATION

TYPICAL ELECTRICAL DISTRIBUTION LAYOUT PLAN FOR ABOVEGROUND TANKS

SHEET REF. NO.

DRN. BY CPB / BC | CKD. BY TMR

FILE NO. | SIZE F | DWG. NO. 78-24-20 | REV.

SPEC. NO. | DATE 5/13/73 | SHEET 22 OF 25

SCOTT GRAPHICS