



TYPICAL DIKE CORNER REINFORCEMENT DETAIL
SCALE: NONE

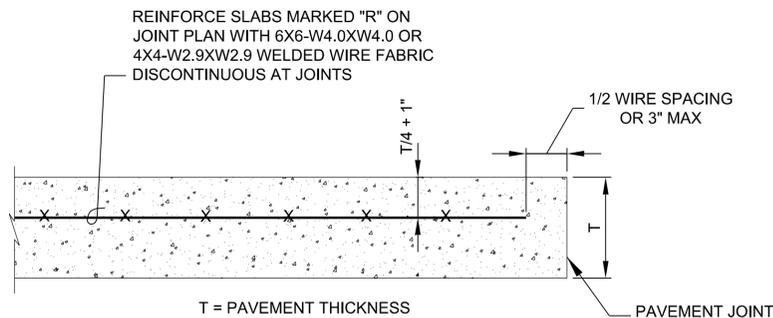


SLAB REINFORCING DETAIL
SCALE: NONE


NOTE:
1. WELDED WIRE FABRIC SHALL BE OVERLAPPED FOR A DISTANCE EQUAL TO AT LEAST ONE SPACING OF THE WIRE IN THE FABRIC OR 32 WIRE DIAMETERS, WHICHEVER IS GREATER. THE WIRES IN THE LAP, SHALL BE WIRED OR OTHERWISE SECURELY FASTENED TO PREVENT SEPERATION DURING CONCRETE PLACEMENT.

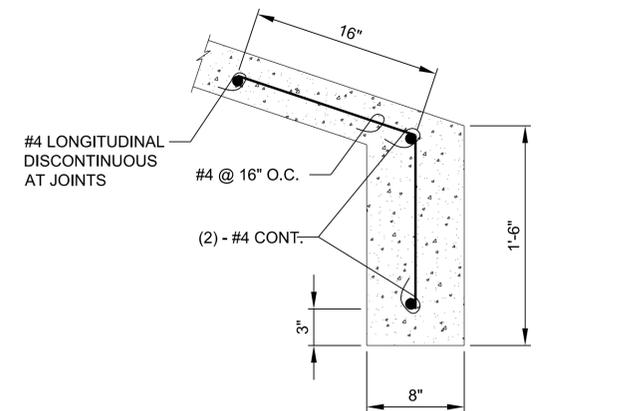


CONCRETE FOOTING DETAIL
SCALE: NONE

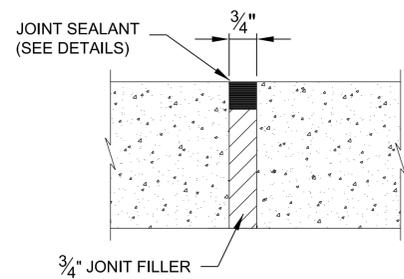


EXPANSION JOINT DETAIL
SCALE: NONE

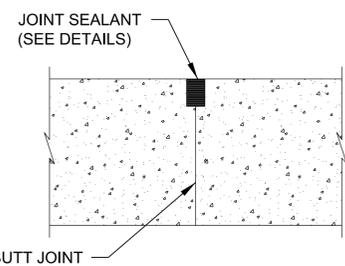


CONSTRUCTION JOINT DETAIL
SCALE: NONE

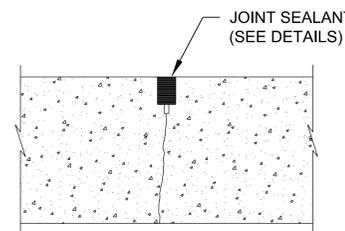


CONTRACTION JOINT DETAIL
SCALE: NONE

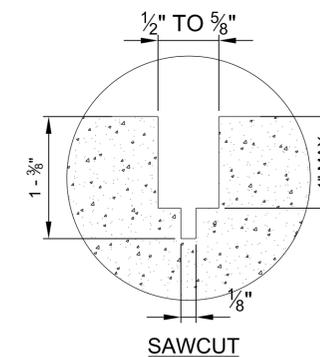


SAWCUT

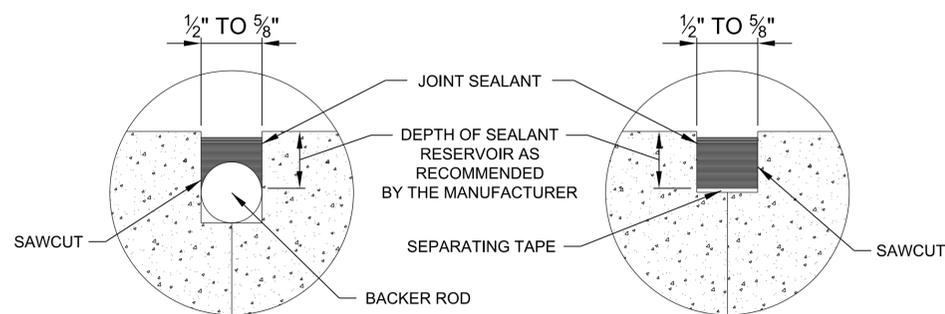

COMPLETED CONSTRUCTION JOINT SEALANT DETAIL
SCALE: NONE

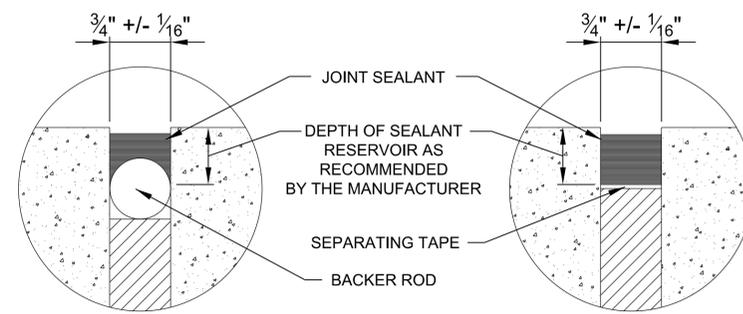

COMPLETED EXPANSION JOINT SEALANT DETAIL
SCALE: NONE

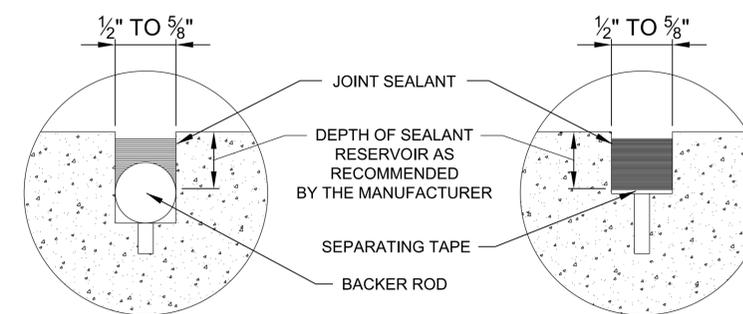

CONTRACTION JOINT SAWCUT DETAILS
SCALE: NONE

DATE	APPR
DESCRIPTION	SWR



APPROVED	A/E INFO
FOR COMMANDER NAVFAC	ACTIVITY
SATISFACTORY TO	DES RLG DRW RLG CHK ELB
SUBMITTED BY:	DATE: APRIL 2015

NAVFACILITIES ENGINEERING COMMAND - ATLANTIC
DOD STANDARD DESIGN AW78-24-27
FUEL TANKS WITH FIXED ROOFS ABOVEGROUND VERTICAL STEEL
DIKE DETAILS - CONCRETE SURFACED

SCALE: AS NOTED
PROJECT NO.: XXXXX
CONSTR. CONTR. NO. XXXXX
NAVFAC DRAWING NO. XXXXX
SHEET 12 OF 57
CD.02