



TYPICAL SECTION - SPILL CONTAINMENT WALLS
SCALE: NONE
CD.03 | CD.08

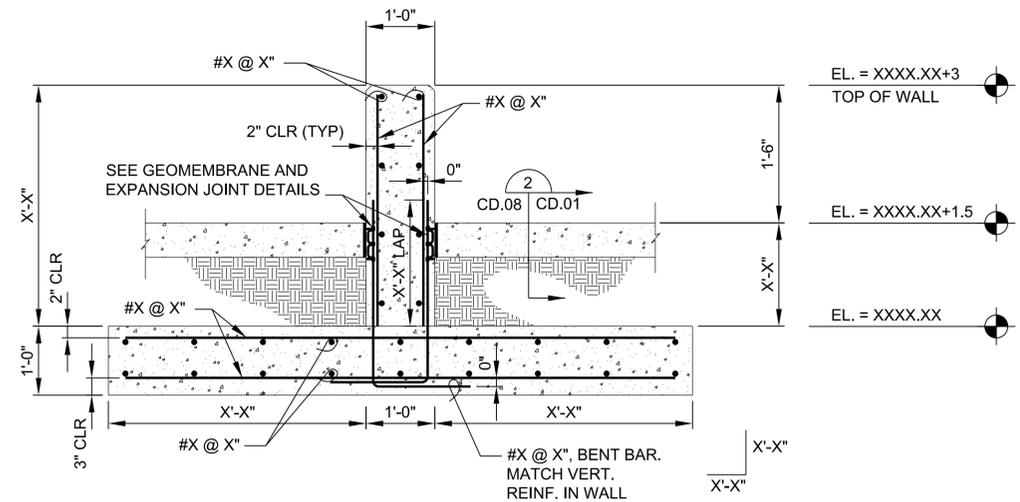


TYPICAL SECTION - SPILL CONTAINMENT INTERMEDIATE WALL
SCALE: NONE

DESIGNER NOTES:


1. CONTAINMENT WALLS SHALL BE DESIGNED BY A STRUCTURAL ENGINEER BASED UPON REQUIRED HEIGHTS AND SOIL CONDITIONS.
2. PROVIDE VERTICAL ROUTED JOINTS AS NECESSARY TO CONTROL CRACKING.

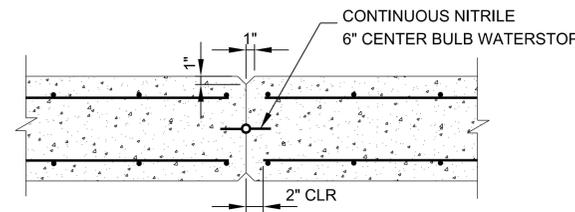

WALL CONTROL JOINT DETAIL
SCALE: NONE

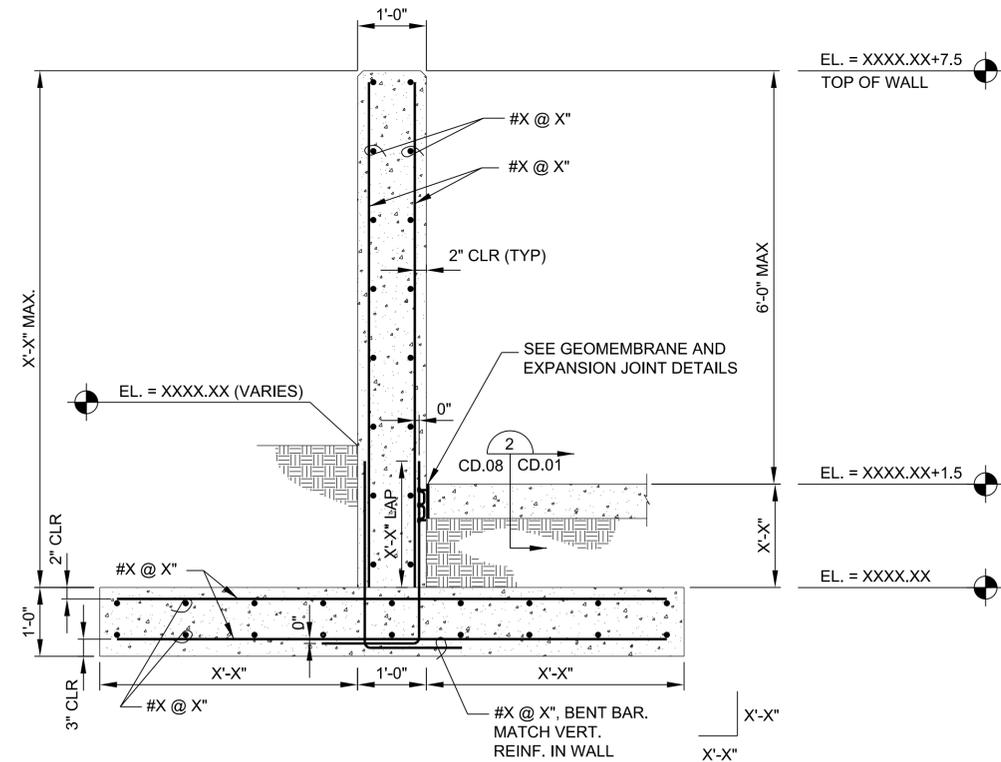


TYPICAL SECTION - SPILL CONTAINMENT WALL
SCALE: NONE
CD.08 | CD.08

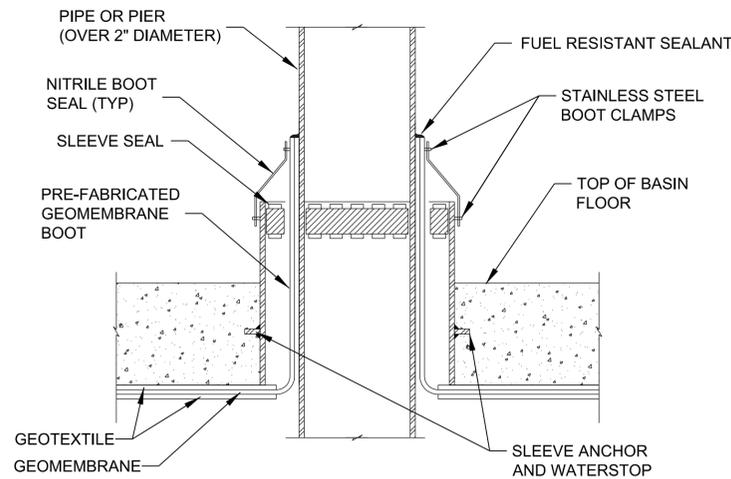

NOTE: FOR PIPES 2" IN DIAMETER OR LESS, SEE DETAIL ON SHEET CD.01.

CONCRETE BASIN FLOOR LARGE PIPE PENETRATION DETAIL
SCALE: NONE

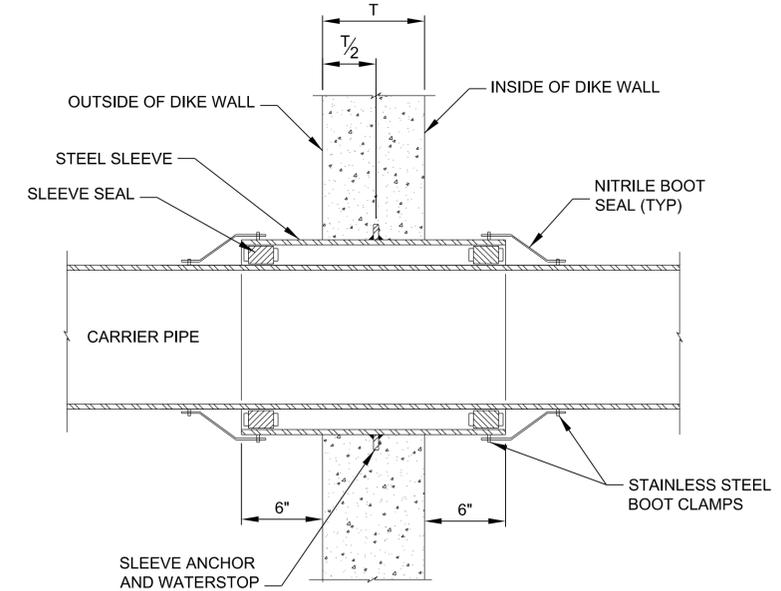

CONCRETE WALL PENETRATION DETAIL
SCALE: NONE

DATE	APPROVED
DESCRIPTION	
DATE	
DESCRIPTION	
DATE	
DESCRIPTION	



US ARMY CORPS OF ENGINEERS
OMAHA DISTRICT

APPROVED	A/E INFO
FOR COMMANDER NAVFAC	
ACTIVITY	
SATISFACTORY TO	
DES RLG	DRW RLG
CHK	ELB
SUBMITTED BY:	
DATE: APRIL 2015	

NAVAL FACILITIES ENGINEERING COMMAND - ATLANTIC
DOD STANDARD DESIGN AW78-24-27
FUEL TANKS WITH FIXED ROOFS ABOVEGROUND VERTICAL STEEL CONTAINMENT WALL DETAILS

SCALE: AS NOTED
PROJECT NO.: XXXXX
CONSTR. CONTR. NO. XXXXX
NAVFAC DRAWING NO. XXXXX
SHEET 17 OF 57

CD.08