




**MECHANICAL TAPE LEVEL GAUGE** 1  
SCALE: NONE  
XX.02<sup>1</sup> D.07

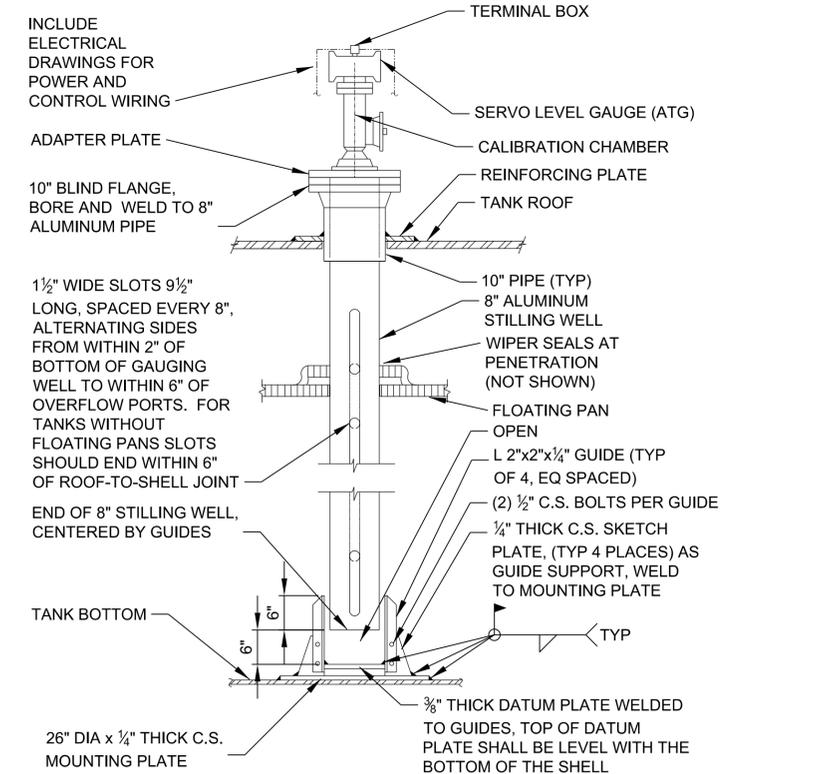


**ATG GAUGE WELL** 4  
SCALE: 3/4"=1'-0"  
XX.02<sup>1</sup> D.07

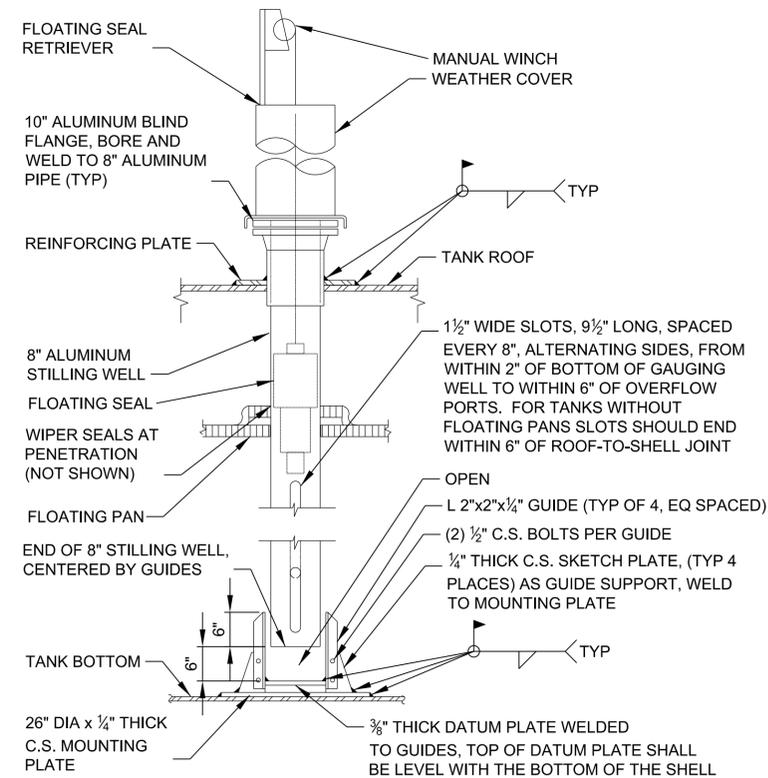


**SAMPLE GAUGE WELL** 2  
SCALE: 3/4"=1'-0"  
XX.02<sup>1</sup> D.07

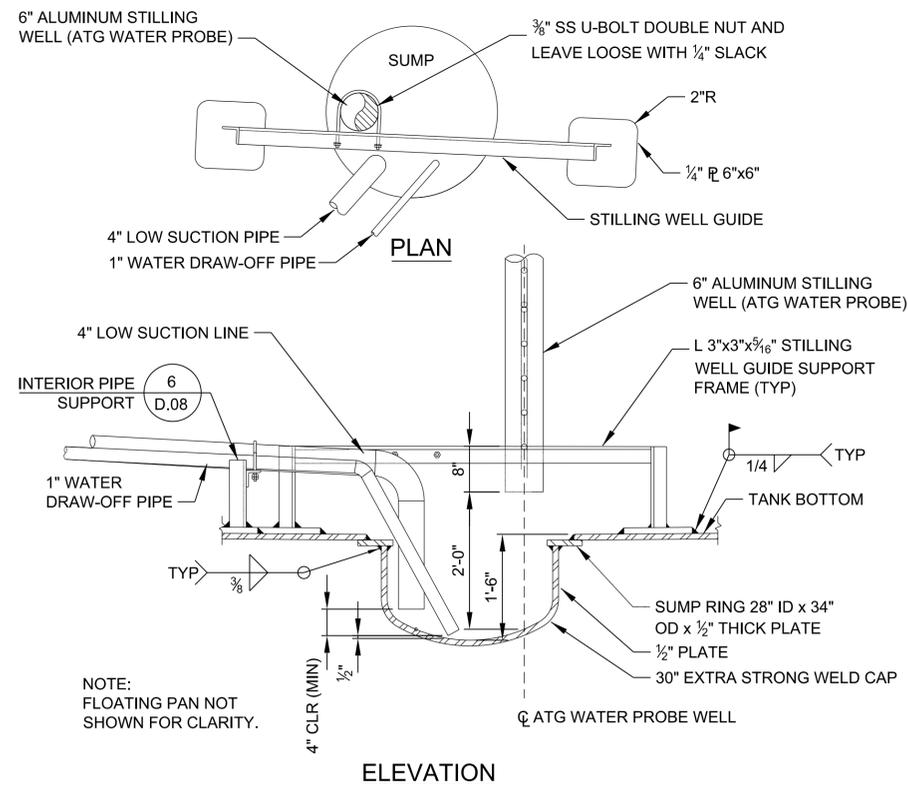

**SUMP AND PIPING** 5  
SCALE: 3/4"=1'-0"  
XX.02<sup>1</sup> D.07  
D.03  
D.07

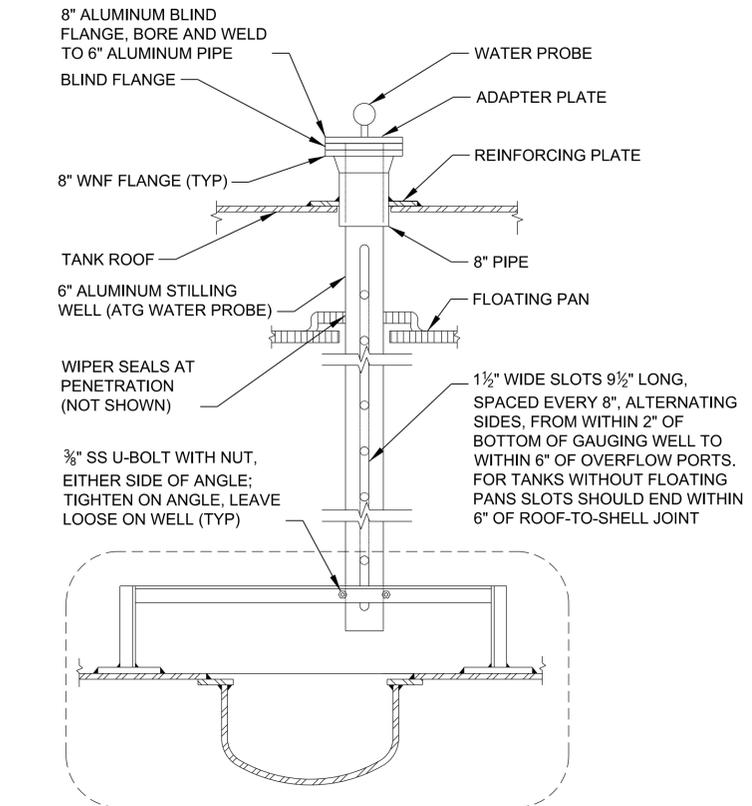

**ATG WATER PROBE WELL** 3  
SCALE: 3/4"=1'-0"  
XX.02<sup>1</sup> D.07

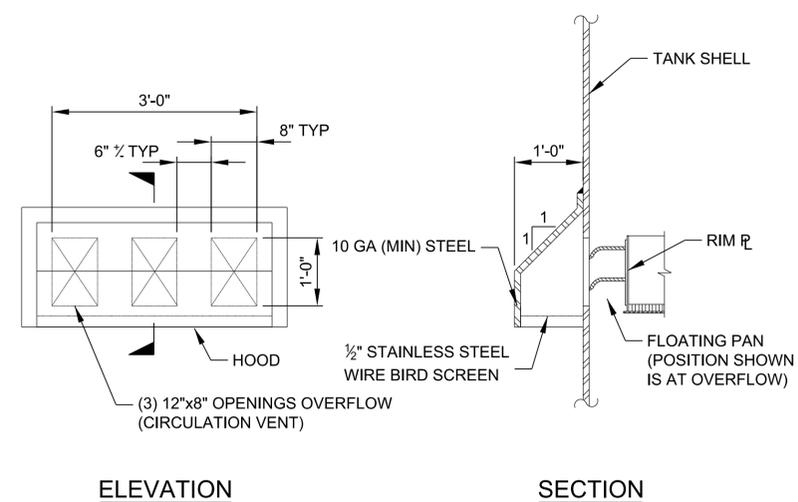

**OVERFLOW/CIRCULATION VENT AND VENT SHELL CIRCULATION VENT** 6  
SCALE: 3/4"=1'-0"  
XX.02<sup>1</sup> D.07

DATE	APP'R
DESCRIPTION	DATE
DATE	APP'R
DESCRIPTION	DATE
US ARMY CORPS OF ENGINEERS OMAHA DISTRICT	
SEAL	
APPROVED	
FOR COMMANDER NAFAC	
ACTIVITY	
SATISFACTORY TO	
DES MSO   DRW MHK   CHK WVB	
SUBMITTED BY:	
DATE: APRIL 2015	
NAVAL FACILITIES ENGINEERING COMMAND - ATLANTIC <b>FUEL TANKS WITH FIXED ROOFS ABOVEGROUND VERTICAL STEEL</b> TYPICAL DETAILS - TANK APPURTENANCES DOD STANDARD DESIGN AW78-24-27	
SCALE: AS NOTED PROJECT NO.: XXXXX CONSTR. CONTR. NO. XXXXX NAFAC DRAWING NO. XXXXX SHEET 51 OF 57	
<b>D.07</b>	
DRAWING REVISION: 10 MAY 2014	

UNCLASSIFIED//FOR OFFICIAL USE ONLY

UNCLASSIFIED//FOR OFFICIAL USE ONLY

D

D

A

A