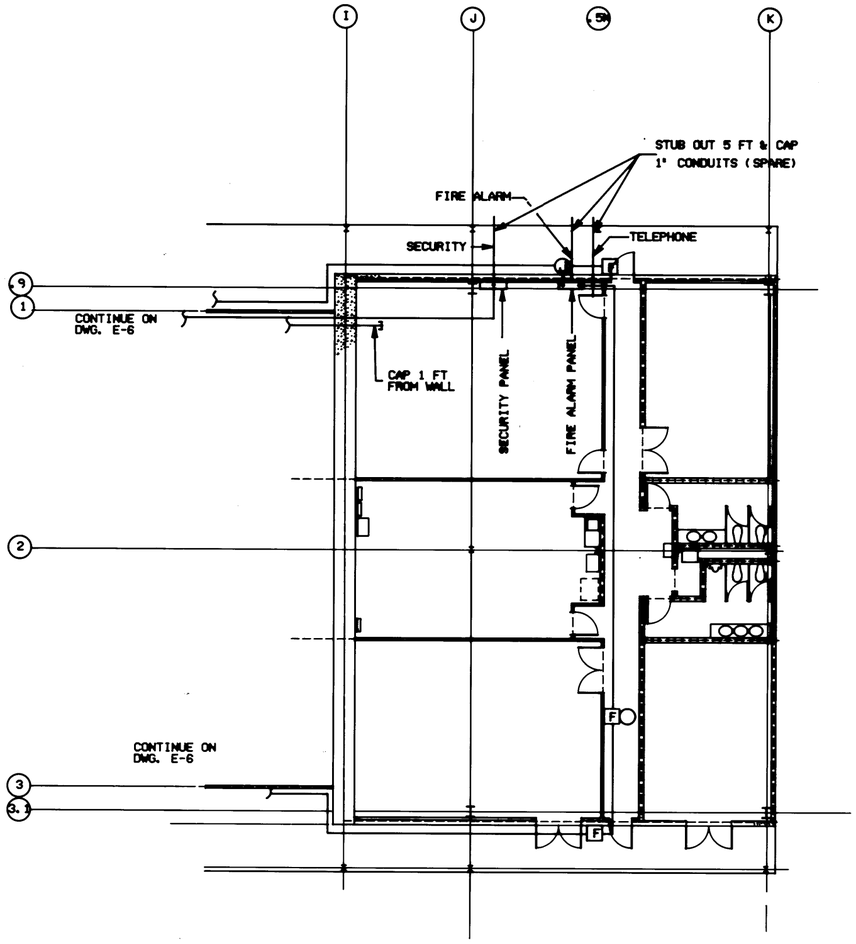

FIRE DETECTION & SECURITY PLAN

NOTES:

1. ALL CONDUIT SYSTEMS WITHIN THE HAZARDOUS AREAS SHALL BE SEALED AS REQUIRED BY THE N.E.C.

LEGEND

- F — FIRE ALARM PULL STATION
- J — JUNCTION BOX
- BALANCED MAGNETIC SWITCH
- FAP — FIRE ALARM PANEL
- SP — SECURITY PANEL
- F — FIRE ALARM BELL
- A — AUTHORIZED ENTRY CONTROL UNIT



Symbol	Description	Date	Approved
	Revisions		

US ARMY ENGINEER DIVISION HUNTSVILLE
CORPS OF ENGINEERS
HUNTSVILLE, ALABAMA

Site adapt A/E :

US Army Corps of Engineers

STANDARD DESIGN
AMMUNITION SURVEILLANCE FACILITY
SUPPORT AREA-FIRE DETECTION & SEC.

Dwn. by : CSB | Ckd. by : JS

Reviewed by : JS | Date : | Sheet reference number : E- 5 | Design file no. : | Rev.

Approved by : | Drawing code : STD 216-12-01 | Sheet of