
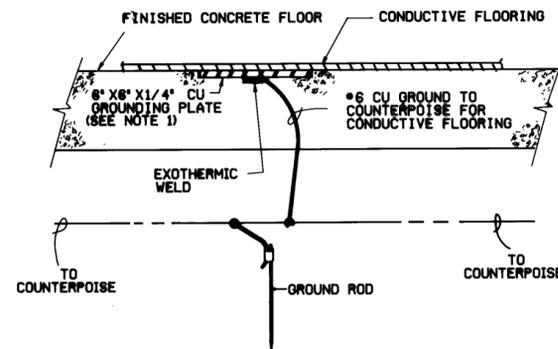
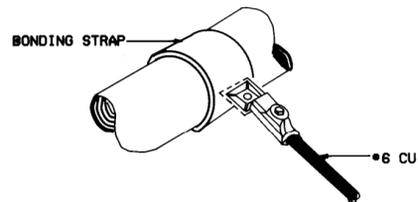


**NOTE**  
1. NUMBER AND LOCATION OF GROUNDING PLATES SHALL BE AS RECOMMENDED BY THE MANUFACTURER OF THE CONDUCTIVE FLOORING, BUT NOT LESS THAN ONE PLATE PER 400 SQUARE FEET.

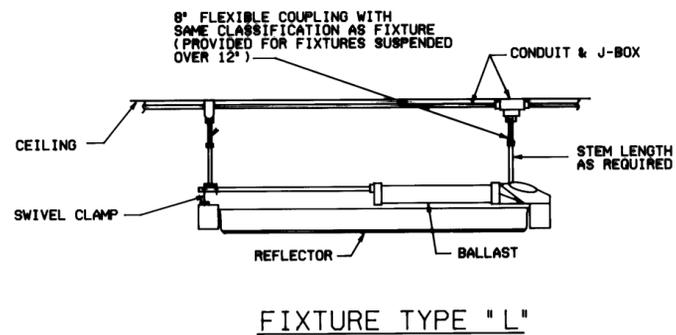

Symbol	Description	Date Approved
Revisions		
US ARMY ENGINEER DIVISION HUNTSVILLE CORPS OF ENGINEERS HUNTSVILLE, ALABAMA		
Site adapt A/E :		
STANDARD DESIGN AMMUNITION SURVEILLANCE FACILITY ELECTRICAL DETAILS SHEET #1		
Down by : CG	Ckd. by : 	Date :
Reviewed by : 	Sheet reference number : E - 11	Design file no. : Rev.
Approved by :	Drawing code : STD 216-12-02	Sheet of