NOTES:

1. PROVIDE TRANSIENT VOLTAGE SURGE SUPPRESSION. UL 1449 TESTED FOR POWER PANEL.

2. ALL UNDERGROUND CONNECTIONS SHALL BE EXOTHERMIC

3. THE MAXIMUM SPACING BETWEEN AIR TERMINAL SHALL NOT EXCEED 25 FT.

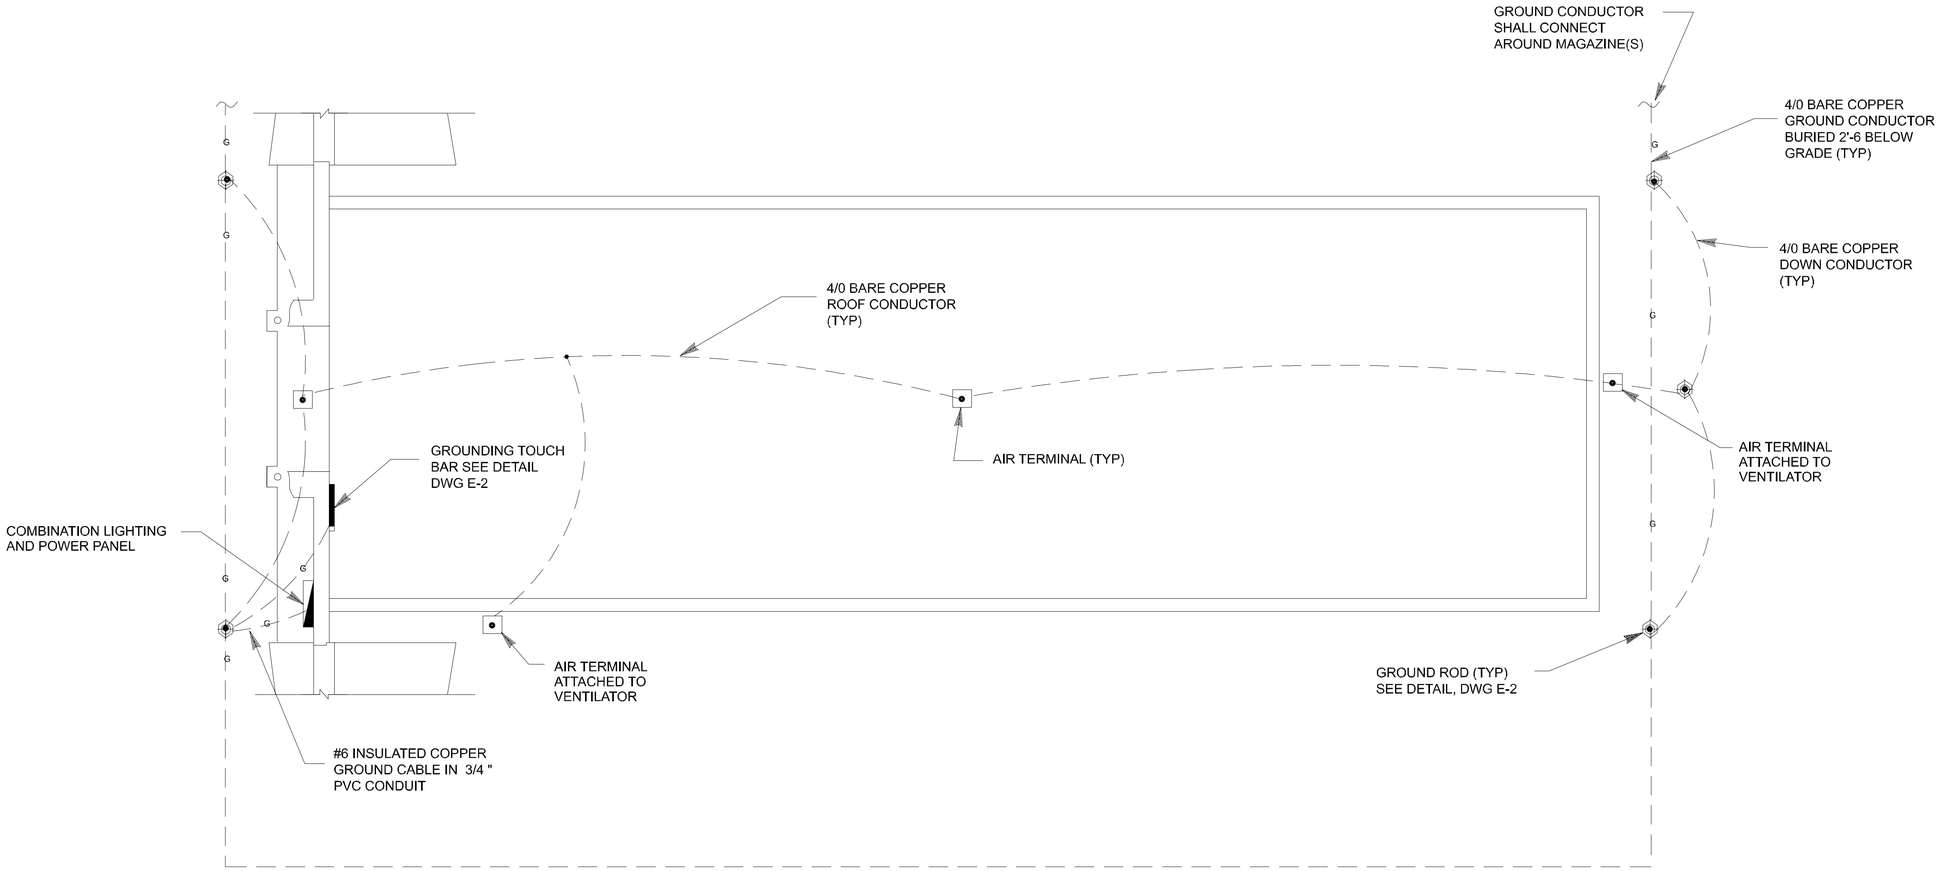

GROUNDING PLAN

SCALE: N.T.S.

US Army Corps of Engineers

Symbol	Description	Date	Approved

Symbol	Description	Date	Approved

Designed by: B. BREWER
Dwn by: RLA
Ckd by: W. STRONG
Reviewed by:
Submitted by: Jeffrey Zysik
Date: MAR 94
Rev.
Design file no. 99 - 421-80-06
Drawing code: 84435
File name: AFE1.dgn
Plot date: " "
Plot scale: 1:

U. S. ARMY ENGINEERING AND SUPPORT CENTER, HUNTSVILLE
HUNTSVILLE, ALABAMA

AIR FORCE MODULAR STORAGE MAGAZINE, BOX-TYPE
421-80-06

GROUNDING PLAN

Sheet reference number:
E - 1

Sheet of